


GENERAL NOTES

- COVER TO REINFORCEMENT TO BE:

LOCATION	COVER
BEAM:	40mm
ALL SIDES	
- REINFORCEMENT TO BE IN ACCORDANCE WITH CONSULTING ENGINEER'S SPECIFICATIONS.
- H - GRADE 500A, CONFORMING TO BS B666:2005.
- ON NO ACCOUNT SHOULD HOLES OR OTHER OPENINGS BE CUT OR ANY REINFORCEMENT BE CUT OR DISPLACED IN ANY PART OF THE STRUCTURE WITHOUT PRIOR APPROVAL OF THE CONSULTING ENGINEER.
- CONCRETE STRENGTH TO BE: RC32/40
- LAP = 35 X BAR DIA (UNLESS NOTED OTHERWISE)

REINFORCEMENT LEGEND

T	- TOP
B	- BOTTOM
SSL	- STRUCTURAL SLAB LEVEL
TOC	- TOP OF CONCRETE
TDB	- TOP OF BEAM

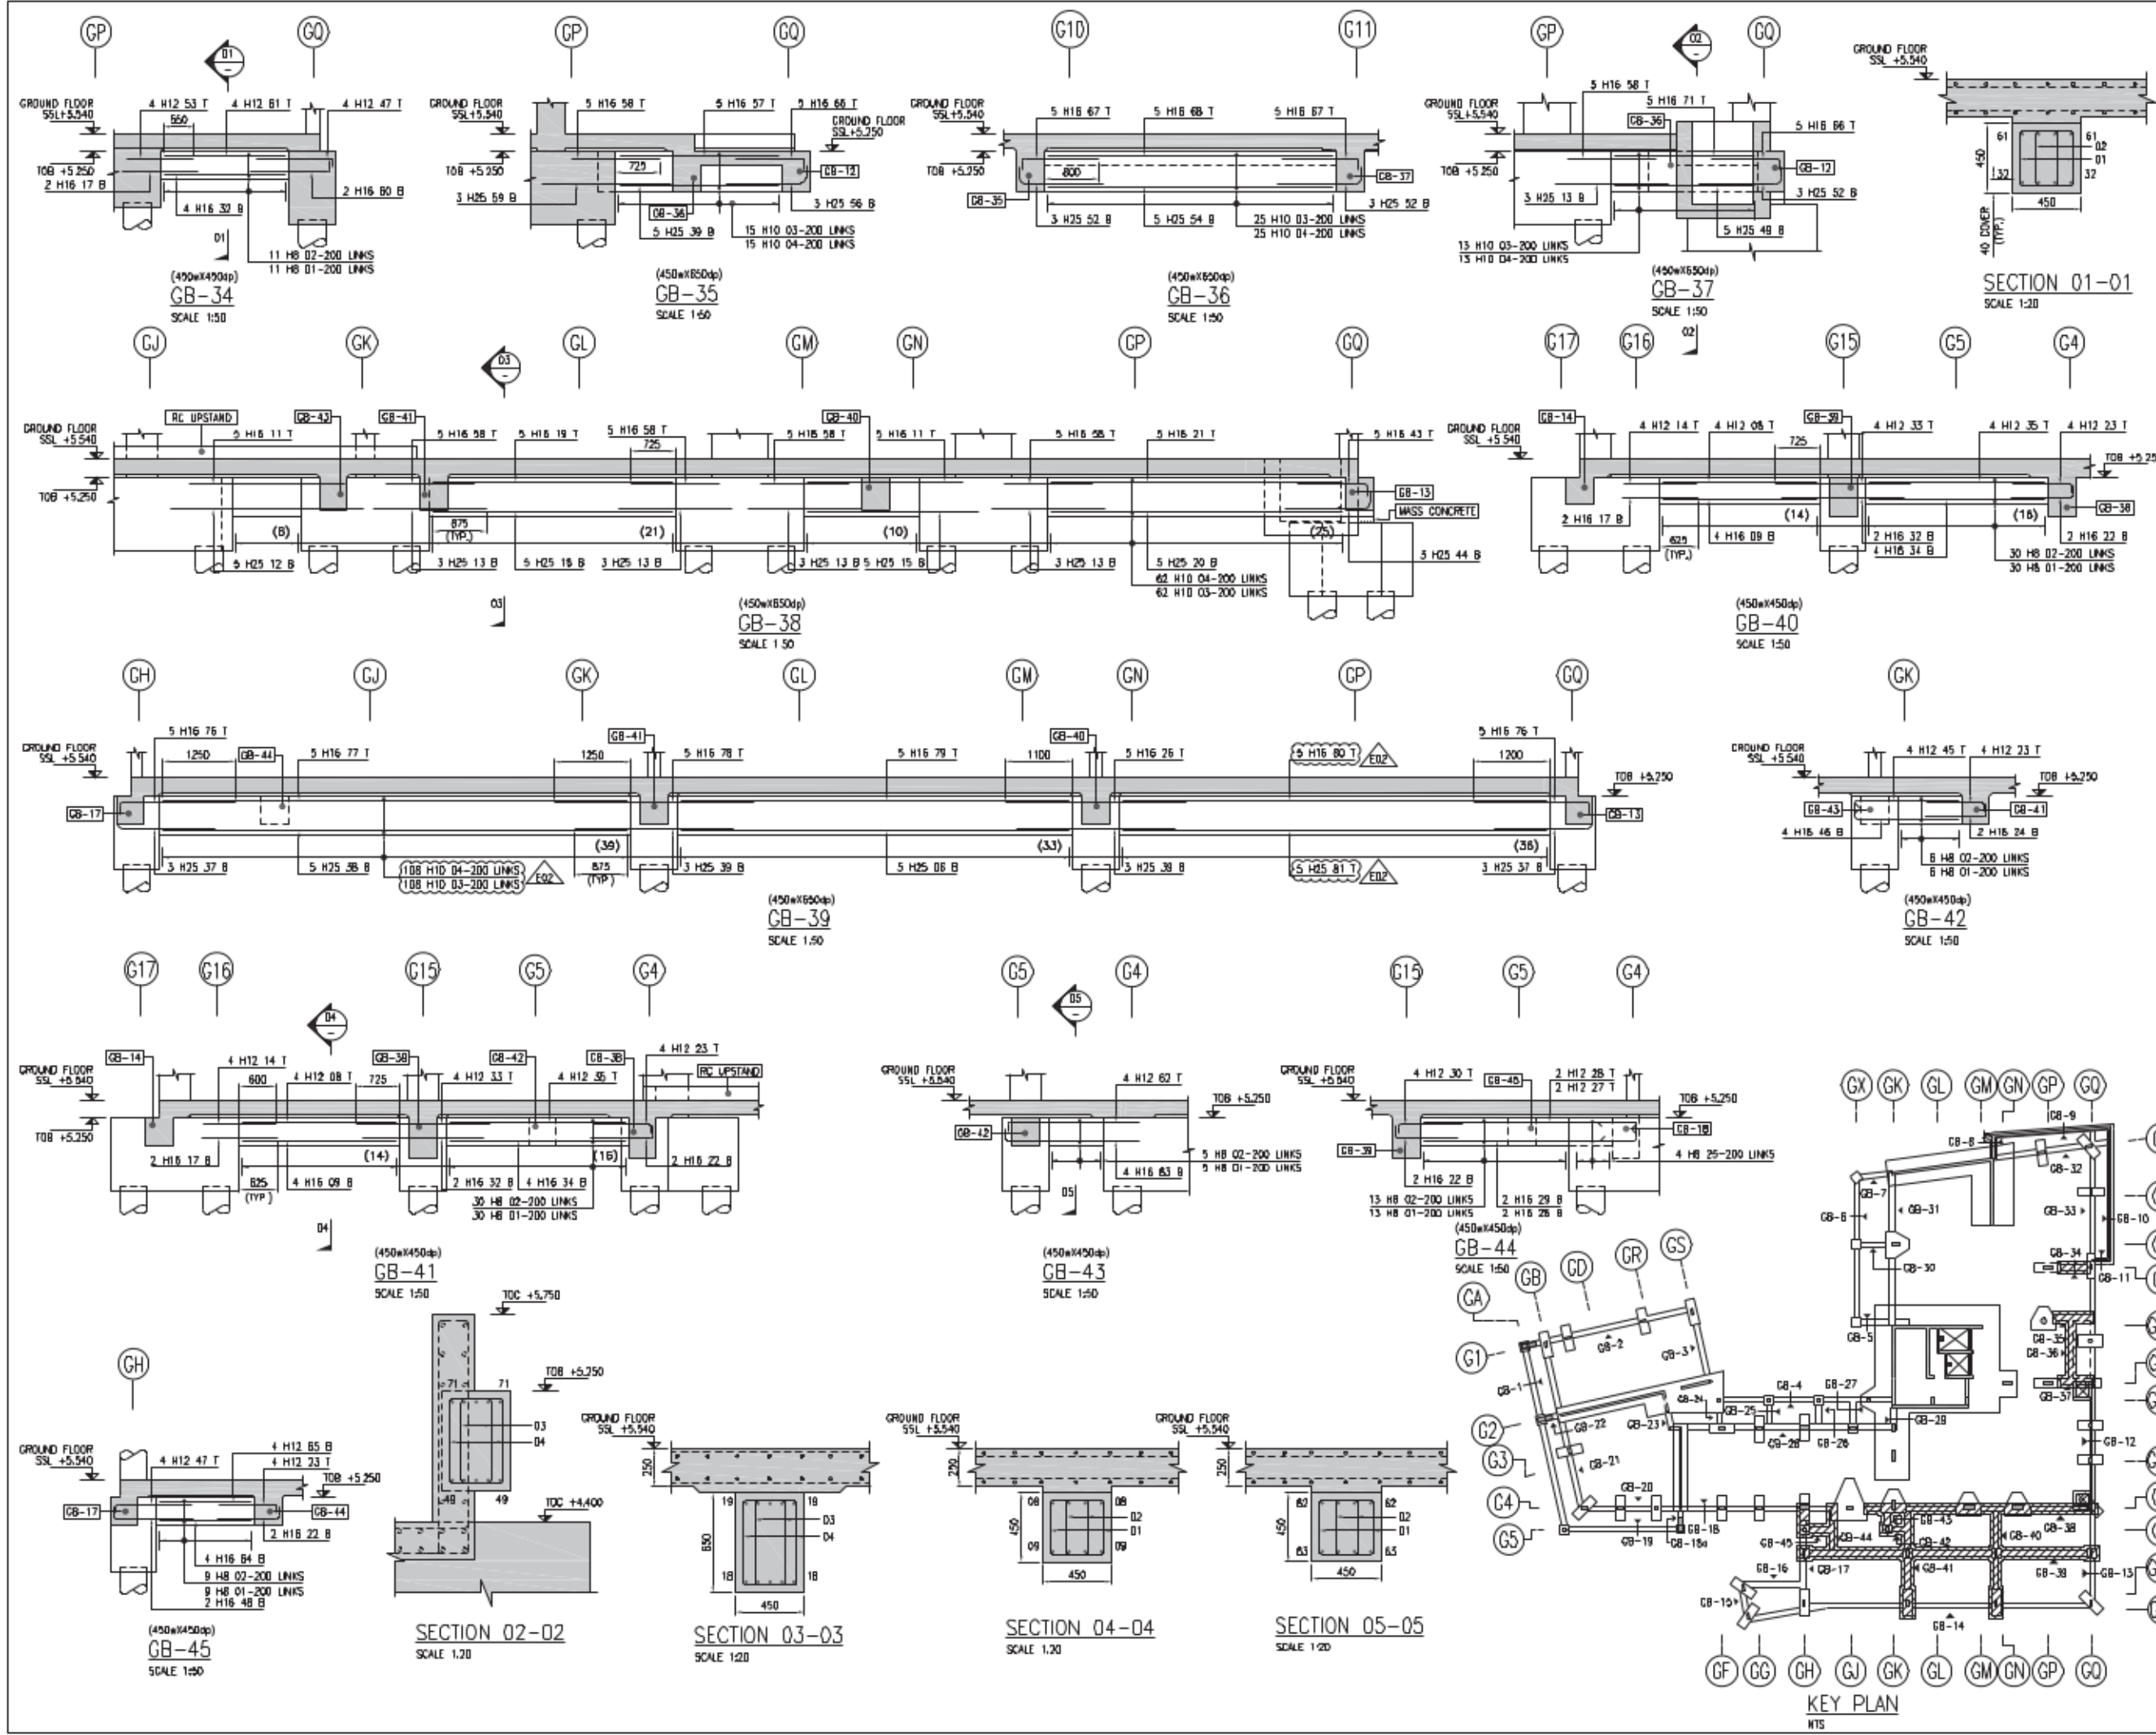

BLOCK G
RC DETAILS OF GROUND BEAMS
SHEET - 4